



TF MULESKINNER SAFETY ALERT



SPACE HEATER SAFETY

A RECENT FIRE IN OUR AO HAD THE POTENTIAL FOR \$100,000 LOSS

RESULTS/LOSS: \$1,000

DESTROYED CART


Bottled water was used to extinguish the fire instead of an available fire extinguisher

DESTROYED PLYWOOD WALL

AFGHANISTAN 12-09

TF MULESKINNER SAFETY ALERT

TF MULESKINNER SAFETY ALERT

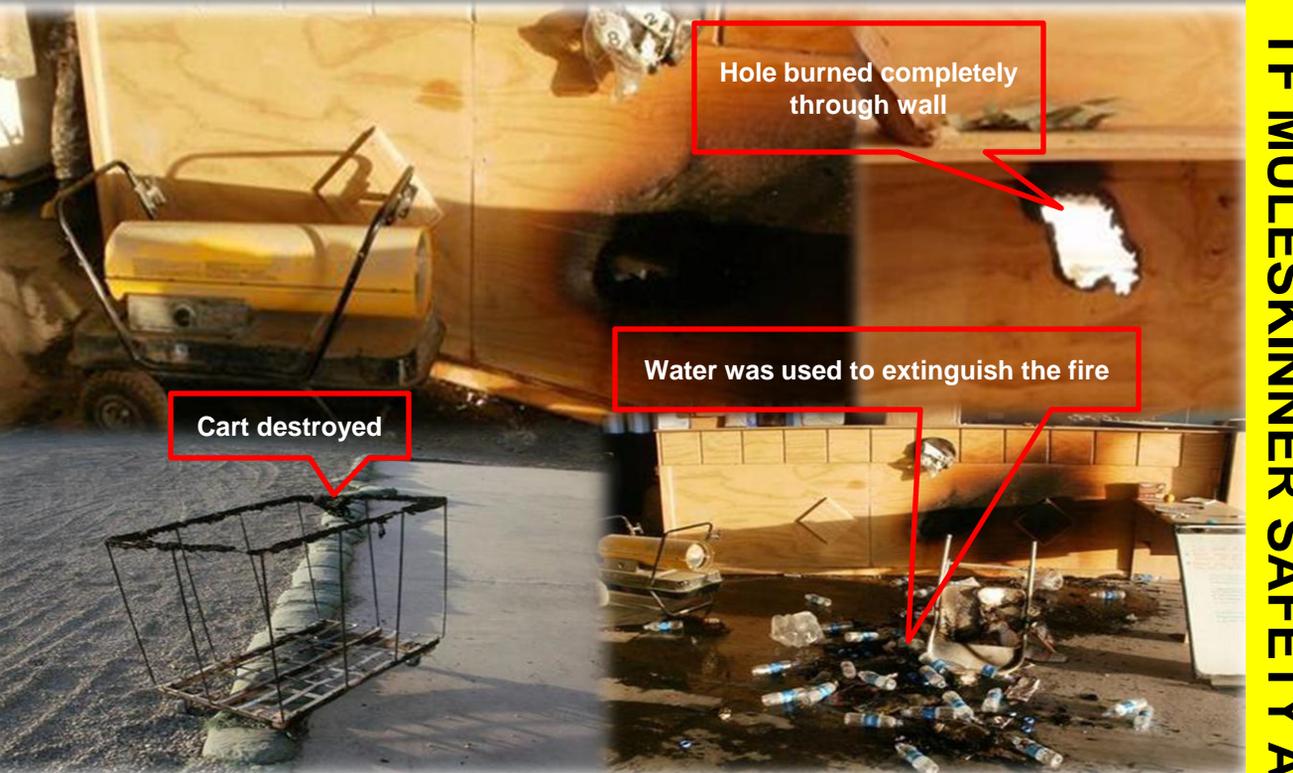

WHEN THE GENERATOR WAS STARTED THE BULLET HEATER STARTED AND WAS IN CLOSE PROXIMATELY TO A PLYWOOD WALL (COMBUSTIBLE SOURCE). AFTER A FEW MINUTES THE HEATER IGNITED THE WALL BURNING THROUGH IT DESTROYING A CART .

- Refer to FRAGO 039 (DTU_Space Heater Safety) to 10th SBDE OPORD 12-01 (TF Muleskinner Sustainment Operations) 121500LDEC11**
- No space heaters of any kind are allowed in any living spaces.
 - This applies to all military and civilian personnel who occupy living quarters assigned/attached to the 10th Sustainment Brigade regardless of location.
 - Space heaters can be used in non-living areas provided all requirements listed in the FRAGO have been met.
 - Provide notification of completion of requirements NLT **22 DEC 11. (Refer to FRAGO)**

TF MULESKINNER SAFETY CONTACT DSN (318)431-3546/3305 ROSHAN (079)985-5997

Think War – Do Right – Build Teams – Eliminate Hassle – Grow Leaders